


FOR EXISTING SERVICE  
 FOR 1 1/2" OR 2" SERVICE USE  
 McDONALD 6102 OR CITY APPROVED EQUAL



FOR NEW SERVICE  
 BALL ANGLE METER STOP FOR  
 1 1/2" OR 2" SERVICE. USE  
 MUELLER B-24276 OR  
 CITY APPROVED EQUAL.

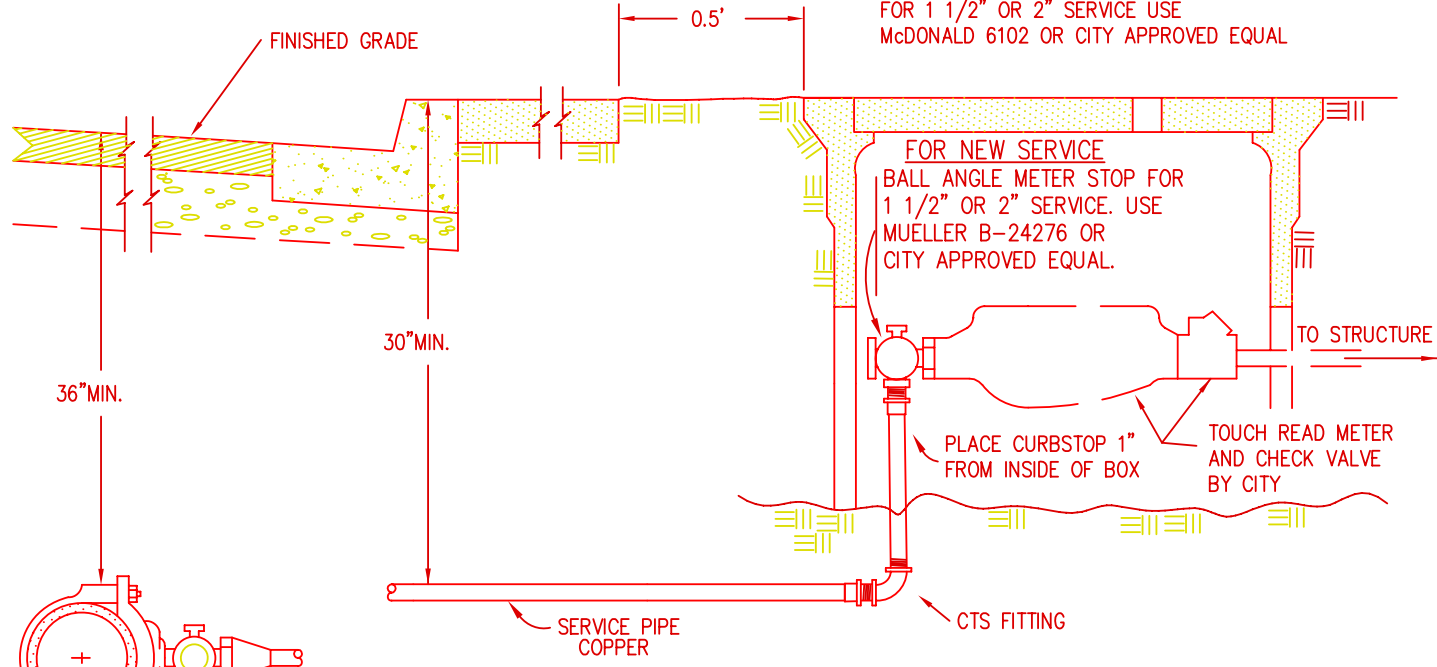

CORPORATION STOP—  
 FORD BALLCORP FB700 OR  
 CITY APPROVED EQUAL.

NOTES:

- 1 1/2" & 2" SERVICES SHALL BE COPPER TYPE "K" UNLESS OTHERWISE SPECIFIED.
- ALL FITTINGS ARE COOPER OR BRASS AND SHALL BE MUELLER 110 (CONDUCTIVE TYPE) COMPRESSION CONNECTIONS OR CITY APPROVED EQUAL.
- INSTALLATION SHOWN IS FOR USE WITH A NON-TURBO TYPE METER.

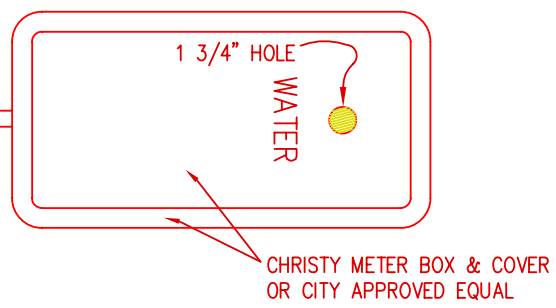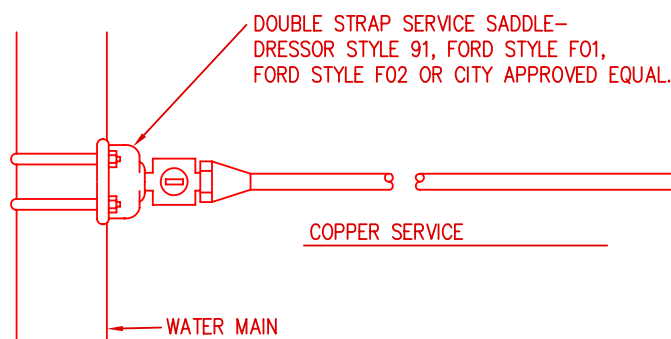

1 1/2" and 2"  
 WATER SERVICE  
 MAIN CONNECTION

METER SIZE	CHRISTY	
	MODEL NO.	LID TYPE *
1 1/2"	B 36	"D"
2"	B 36	"D"

\* WITH 1 3/4" HOLE / TRPL



DEPARTMENT OF CITY SERVICES

STANDARD DETAIL 406

APPROVED \_\_\_\_\_ DATE \_\_\_\_\_

Water Service 1 1/2" and 2" Connection