


NOTE:
 SEE CITY OF YUBA CITY STANDARD DETAIL 405
 FOR SERVICE CONNECTION AND METER BOX SIZES



1. REDUCED PRESSURE BACK FLOW PREVENTION ASSM. MUST BE CONNECTED TO CITY WATER & TESTED BY CERTIFIED TESTOR WITH AN AWWA CERTIFICATION PRIOR TO BEING PLACED INTO SERVICE.
2. POINT OF SERVICE:
 - A. POINT OF SERVICE IS THE BACK OF SIDEWALK FOR STREETS WITH SIDEWALK CONTIGUOUS WITH CURB & GUTTER.
 - B. POINT OF SERVICE IS THE RIGHT OF WAY LINE ON ALL ALLEYS & UNIMPROVED STREETS.
 - C. WHERE THE POINT OF SERVICE IS UNCLEAR THE LOCATION SHALL BE DETERMINED BY THE CROSS CONNECTION CONTROL SPECIALIST OR HIS DESIGNEE.
3. LISTS OF APPROVED BACK FLOW PREVENTION ASSEMBLIES:
 FEBCO, WATTS OR CITY APPROVED EQUAL.
4. THE BACK FLOW PREVENTION ASSEMBLIES SHALL BE INSTALLED ABOVE GROUND, IN A HORIZONTAL & LEVEL POSITION. THE ASSEMBLY SHALL BE LOCATED ON THE CUSTOMER'S SIDE & NO FURTHER THAN FIVE (5) FEET FROM THE POINT OF SERVICE OF THE WATER METER.
5. NO OUTLET, TAP, TEE, OR CONNECTION BETWEEN THE WATER MAIN AND THE BACK FLOW PREVENTER IS ALLOWED UNLESS APPROVED BY THE CITY ENGINEER

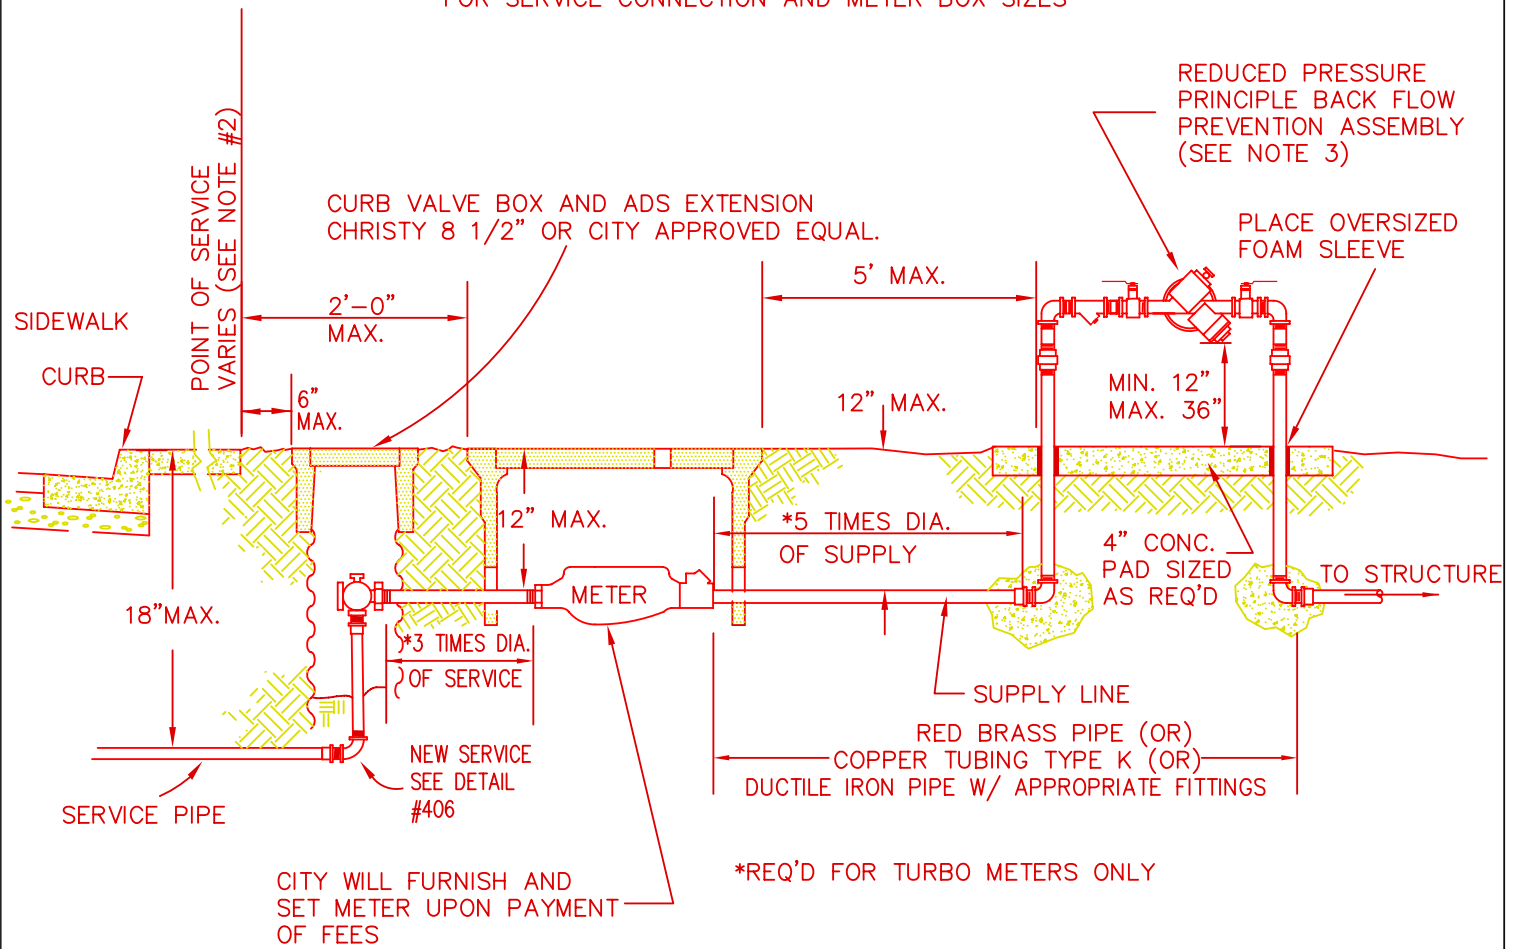

526 C Street, Marysville, CA 95901

DEPARTMENT OF CITY SERVICES

STANDARD DETAIL 408

 APPROVED DATE

Reduced Pressure
 Back Flow Preventer